



Test Report: TDR-240-48

240W Slim Three Phase Industrial DIN Rail with PFC Function

■ DESIGN VERIFY TEST

Output Function Test

Input Function Test

Protection Function Test

Control Function Test

Component Stress Test

■ SAFETY & E.M.C. TEST

Safety Test

E.M.C. Test

■ RELIABILITY TEST


ENVIRONMENT TEST

DESIGN VERIFY TEST

OUTPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OUTPUT VOLTAGE ADJUST RANGE	CH1: 48.0V~ 55.0V	I/P : 400 VAC O/P : MIN LOAD Ta : 25°C	46.45V~57.75V
2	OUTPUT VOLTAGE(Max) TOLERANCE	V1: -1.0%~1.0%	I/P: 340VAC /550VAC O/P:FULL/ MIN. LOAD Ta:25°C	V1 : -0.07%~0.04%
3	LINE REGULATION (Max)	V1: -0.5%~ 0.5%	I/P: 340VAC~ 550VAC O/P:FULL LOAD Ta:25°C	V1 : -0.02%~0.02%
4	LOAD REGULATION(Max)	V1: -1.0%~1.0%	I/P: 400VAC O/P:FULL ~MIN LOAD Ta:25°C	V1 : -0.07%~0.04%
5	OVER/UNDERSHOOT TEST	< ±5%	I/P: 400VAC O/P:FULL LOAD Ta:25°C	2.1%
6	RIPPLE & NOISE(Max)	V1: 150mVp-p	I/P:400VAC O/P:FULL LOAD Ta:25°C	V1: 21mVp-p

high frequency (V1) :

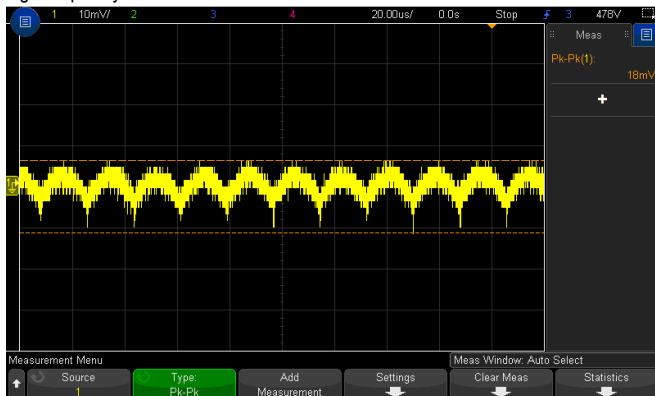


low frequency (V1):



7	SET UP TIME(Max)	500VAC/1500ms 400VAC/2000ms	I/P : 500 VAC I/P : 400 VAC O/P : FULL LOAD Ta : 25°C	500VAC/ 520ms 400VAC/674ms
---	------------------	--------------------------------	--	-------------------------------


INPUT=500VAC/50HZ @ FULL LOAD

CH1 : Output Voltage CH2 : AC Input Voltage

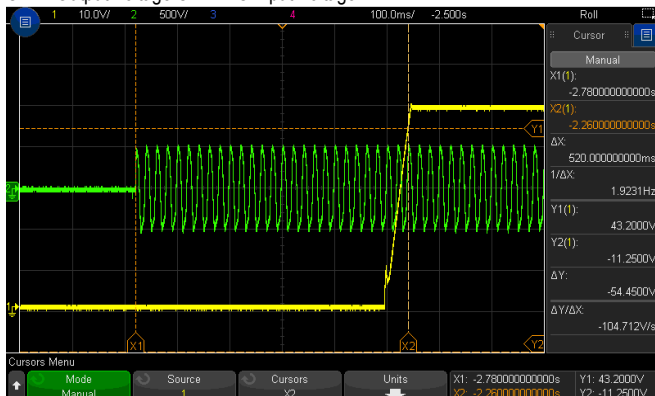

INPUT=400VAC/50HZ @ FULL LOAD

CH1 : Output Voltage CH2 : AC Input Voltage

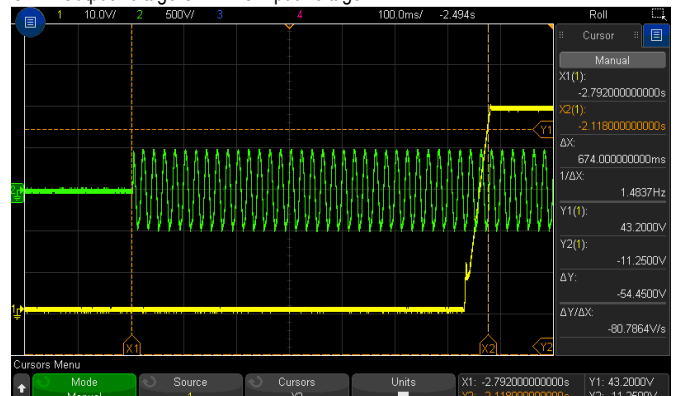



8 RISE TIME (Max)	500VAC/60ms 400VAC/60ms	I/P : 500 VAC I/P : 400 VAC O/P : FULL LOAD Ta : 25°C	500VAC/43.1ms 400VAC/ 41.7ms
INPUT=500VAC/50HZ @ FULL LOAD CH1 : Output Voltage		INPUT=400VAC/50HZ @ FULL LOAD CH1 : Output Voltage	
9 HOLD UP TIME (Typ.)	500VAC/40ms 400VAC/20ms	I/P : 500 VAC I/P : 400 VAC O/P : FULL LOAD Ta : 25°C	500VAC/ 59ms 400VAC/ 34ms
INPUT=500VAC/50HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage		INPUT=400VAC/50HZ @ FULL LOAD CH1 : Output Voltage CH2 : AC Input Voltage	
10 DYNAMIC LOAD	V1: 4800 mVp-p	I/P: 400VAC O/P: (1)FULL /50% LOAD 50%DUTY / 120HZ (2)FULL /50% LOAD 50%DUTY / 1KHZ Ta:25°C	(1) V1: 910mVp-p (2) V1: 531mVp-p
FULL /50% LOAD 50%DUTY / 120HZ (V1)		FULL /50% LOAD 50%DUTY / 1KHZ (V1)	

INPUT FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	INPUT VOLTAGE RANGE	340VAC~550VAC 480VDC~780VDC	I/P:TESTING O/P:FULL LOAD Ta:25°C	277VAC~550VAC 460VDC~780VDC
			I/P: LOW-LINE-3V=337 V HIGH-LINE+15%=560 V O/P:FULL/MIN LOAD (PLEASE CHECK DERATING CURVE) ON: 30 Sec OFF: 30 Sec 10MIN (POWER ON/OFF NO DAMAGE)	TEST:OK
2	INPUT FREQUENCY RANGE	47HZ ~63 HZ NO DAMAGE	I/P:340 VAC ~550 VAC O/P:FULL~MIN LOAD Ta:25°C	TEST: OK
3	INPUT CURRENT (Typ.)	500V/0.6A 400V/ 0.69A	I/P : 500 VAC I/P : 400 VAC O/P : FULL LOAD Ta : 25°C	IR =0.642A/ 400VAC IS =0.638A/ 400VAC IT =0.642A/ 400VAC
				IR =0.541A/ 500VAC IS =0.543A/ 500VAC IT =0.541A/ 500VAC
4	POWER FACTOR (Typ.)	≥ 0.53/400VAC ≥ 0.52/500VAC	I/P : 400 VAC I/P : 500 VAC O/P : FULL LOAD Ta : 25°C	0.59/400VAC R 0.595/400VAC S 0.593/400VAC T
				0.561/500VAC R 0.573/500VAC S 0.572/500VAC T
5	LEAKAGE CURRENT	<2.00mA	I/P : 530 VAC O/P : Min LOAD Ta : 25°C	N1,N2,N3 and Earth:1.5mA
6	EFFICIENCY(Typ.)	92%	I/P:400 VAC O/P:FULL LOAD Ta:25°C	93.3%

EFFICIENCY vs LOAD

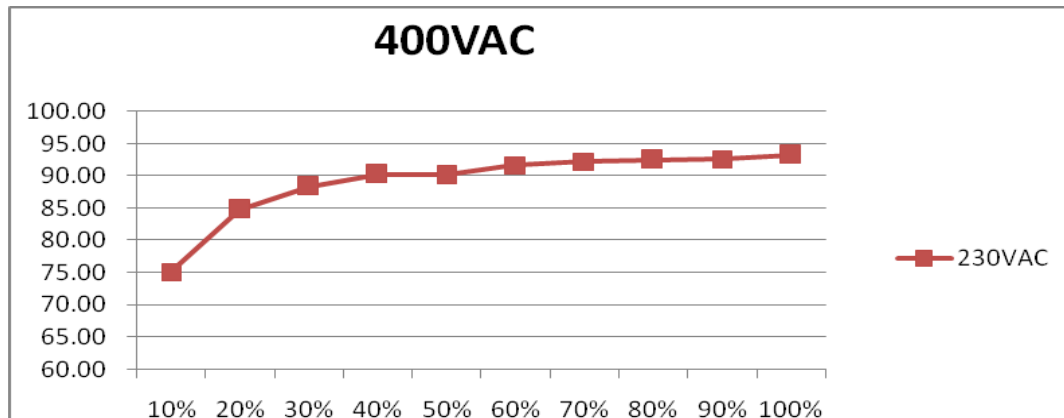

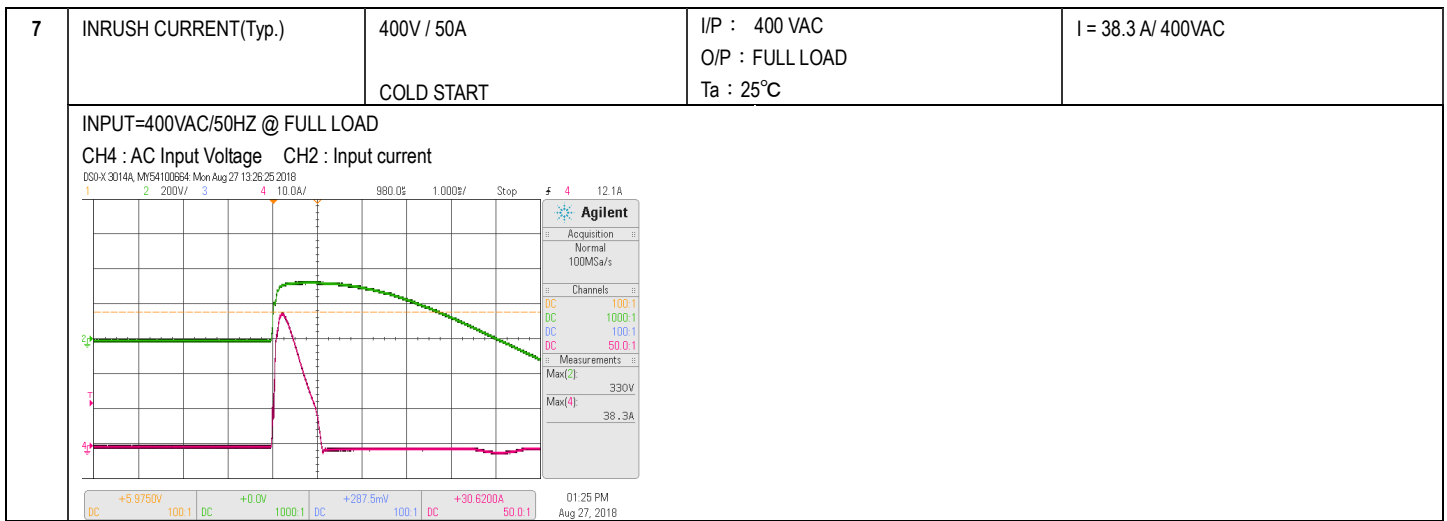

PROTECTION FUNCTION TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	OVER LOAD PROTECTION	105%~135%	I/P: 550VAC I/P: 400VAC I/P: 340VAC O/P: TESTING Ta:25°C	118.6%/ 550VAC 118.6%/ 400VAC 118.4%/340VAC PROTECTION TYPE : Constant current limiting, unit will hiccup after 3sec.
2	OVER VOLTAGE PROTECTION	56.0V~65.0V	I/P: 550VAC I/P: 400VAC I/P: 340VAC O/P: MIN LOAD Ta:25°C	61.6V/ 550VAC 61.6V/ 400VAC 61.6V/ 340VAC PROTECTION TYPE : Hiccup mode, recovers automatically after fault condition is removed
3	OVER TEMPERATURE PROTECTION	Shut down o/p voltage	I/P: 550VAC I/P: 340VAC O/P: FULL LOAD Ta:25°C	TEST: PROTECTION TYPE : Shut down o/p voltage, recovers automatically after temperature goes down
4	SHORT PROTECTION	SHORT EVERY OUTPUT 1 HOUR NO DAMAGE	I/P: 550VAC I/P: 340VAC O/P: FULL LOAD Ta:25°C	NO DAMAGE PROTECTION TYPE : Hiccup Mode

COMPONENT STRESS TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	PWM Transistor (D to S) or (C to E) Peak Voltage	Q1 Rated : 950 V	AC ON/OFF I/P: High-Line +3V =553V VDS: O/P: (1) Full Load (2) Output Short (3) Full Load Continue Ta:25°C	VDS: (1) 787V (2) 771V (3) 787V
2	O/P MOFET	Q100 Rated : 200 V Q101 Rated : 200 V	AC ON/OFF I/P: High-Line +3V =553 V O/P: (1) Full Load (2) Output Short (3) Full Load Continue Ta:25°C	Q100 Q101 VDS: VDS: (1) 165V (1) 165V (2) 167V (2) 167V (3) 165V (3) 165V



3	Input Capacitor Voltage	C5 Rated :150 μ f/ 400 V	I/P:High-Line +3V =553V O/P: (1)Full Load input on/off (2) Min load input on /Off (3)Full Load /Min load Change (4)Full load continue Ta:25°C	(1) 386V (2) 386V (3) 386V (4) 378 V
4	Control IC Voltage Test	U1 Rated : 11V~ 26 V U100 Rated : 0V~ 37 V	AC ON/OFF I/P:High-Line +3V =553 V O/P(1)FULL LOAD (2) Output Short (3)O.L.P (4)O.V.P. (5)NO LOAD VRmin(LOW LINE) Ta:25°C	U1 (1) 17.2V (2) 17.8V (3) 17.4V (4) 18.0V (5) 17.0V
5	Clamp Diode Peak Voltage	D22-D23 Rated : 600V*2V	AC ON/OFF I/P : High-Line +3V =553 V O/P : (1) Dynamic Load 90%Duty/1KHz (2)Full load continue Ta : 25°C	(1) 899V (2) 794V

SAFETY TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	WITHSTAND VOLTAGE	I/P-O/P: 4.87KVAC/min I/P-FG: 2.4KVAC/min O/P-FG: 0.5KVAC/min O/P-DC OK:0.5KVAC/min	I/P-O/P: 5.0KVAC/min I/P-FG: 2.88KVAC/min O/P-FG: 0.6KVAC/min O/P-DC OK:0.6KVAC/min Ta:25°C	I/P-O/P: 8.28mA I/P-FG: 6.40mA O/P-FG: 4.39mA O/P-DC OK: 0.005mA NO DAMAGE
2	ISOLATION RESISTANCE	I/P-O/P:500VDC>100MΩ I/P-FG:500VDC>100MΩ O/P-FG:500VDC>100MΩ	I/P-O/P:500VDC I/P-FG:500VDC O/P-FG:500VDC Ta:25°C	I/P-O/P: 9999 MΩ I/P-FG: 9999 MΩ O/P-FG: 9999 MΩ NO DAMAGE
3	GROUNDING CONTINUITY	FG(PE) TO CHASSIS OR TRACE < 100 mΩ	40 A / 2min Ta: 25°C/70%RH	10 mΩ

E.M.C TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT
1	HARMONIC	EN61000-3-2 CLASS A	I/P:400VAC/50HZ O/P:FULL LOAD Ta:25°C	<input checked="" type="checkbox"/> PASS <input type="checkbox"/> FAIL
2	CONDUCTION	EN61204-3 CLASS B	I/P : 400 VAC (50HZ) O/P : FULL/50% LOAD Ta : 25°C	PASS Test by certified Lab
3	RADIATION	EN61204-3CLASS B	I/P : 400 VAC (50HZ) O/P : FULL LOAD Ta : 25°C	PASS Test by certified Lab
4	E.S.D	EN61000-4-2 <input type="checkbox"/> LIGHT INDUSTRY AIR: 8KV / Contact: 4KV <input type="checkbox"/> INDUSTRY AIR: 8KV / Contact: 4KV <input checked="" type="checkbox"/> Din rail Model: AIR: 15KV / Contact: 8KV	I/P : 400 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A



5	E.F.T	EN61000-4-4 <input type="checkbox"/> LIGHT INDUSTRY INPUT : 1KV <input type="checkbox"/> MEDICAL <input checked="" type="checkbox"/> INDUSTRY INPUT : 2KV	I/P : 400 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
6	SURGE	EN61000-4-5 INDUSTRY L-N : 2KV L/N-PE: 4KV	I/P : 400 VAC/50HZ O/P : FULL LOAD Ta : 25°C	CRITERIA A
7	Test by certified Lab & Test Report Prepare			

RELIABILITY TEST

ENVIRONMENT TEST

NO	TEST ITEM	SPECIFICATION	TEST CONDITION	RESULT																																																																																												
1	TEMPERATURE RISE TEST	MODEL : TDR-240-24 1. ROOM AMBIENT BURN-IN : 1 HRS I/P : 400VAC O/P : FULL LOAD Ta= 25.5 °C 2. HIGH AMBIENT BURN-IN : 1 HRS I/P : 400VAC O/P : FULL LOAD Ta= 60.5 °C																																																																																														
		<table border="1"> <thead> <tr> <th>NO</th> <th>Position</th> <th>ROOM AMBIENT Ta= 25.5 °C</th> <th>HIGH AMBIENT Ta= 60.5 °C</th> </tr> </thead> <tbody> <tr><td>1</td><td>L3</td><td>44.0°C</td><td>81.4°C</td></tr> <tr><td>2</td><td>C2</td><td>51.1°C</td><td>88.4°C</td></tr> <tr><td>3</td><td>ZR4</td><td>57.2°C</td><td>93.7°C</td></tr> <tr><td>4</td><td>C125</td><td>55.8°C</td><td>93.3°C</td></tr> <tr><td>5</td><td>LF10</td><td>70.5°C</td><td>107.7°C</td></tr> <tr><td>6</td><td>U100</td><td>72.9°C</td><td>110.1°C</td></tr> <tr><td>7</td><td>D10</td><td>68.2°C</td><td>104.3°C</td></tr> <tr><td>8</td><td>D7</td><td>60.5°C</td><td>97.2°C</td></tr> <tr><td>9</td><td>C255</td><td>66.0°C</td><td>102.2°C</td></tr> <tr><td>10</td><td>LF2</td><td>65.0°C</td><td>100.5°C</td></tr> <tr><td>11</td><td>C106</td><td>74.7°C</td><td>100.0°C</td></tr> <tr><td>12</td><td>C110</td><td>68.4°C</td><td>104.5°C</td></tr> <tr><td>13</td><td>C15</td><td>52.3°C</td><td>88.8°C</td></tr> <tr><td>14</td><td>U1</td><td>62.7°C</td><td>100.4°C</td></tr> <tr><td>15</td><td>C5</td><td>52.2°C</td><td>89.3°C</td></tr> <tr><td>16</td><td>C200</td><td>66.8°C</td><td>103.2°C</td></tr> <tr><td>17</td><td>Q101</td><td>62.4°C</td><td>100.6°C</td></tr> <tr><td>18</td><td>L5</td><td>46.6°C</td><td>83.7°C</td></tr> <tr><td>19</td><td>T1</td><td>96.2°C</td><td>106.0°C</td></tr> <tr><td>20</td><td>Q1</td><td>60.4°C</td><td>100.0°C</td></tr> <tr><td>21</td><td>C72</td><td>60.8°C</td><td>99.0°C</td></tr> <tr><td>22</td><td>D22</td><td>78.7°C</td><td>118.6°C</td></tr> </tbody> </table>	NO	Position	ROOM AMBIENT Ta= 25.5 °C	HIGH AMBIENT Ta= 60.5 °C	1	L3	44.0°C	81.4°C	2	C2	51.1°C	88.4°C	3	ZR4	57.2°C	93.7°C	4	C125	55.8°C	93.3°C	5	LF10	70.5°C	107.7°C	6	U100	72.9°C	110.1°C	7	D10	68.2°C	104.3°C	8	D7	60.5°C	97.2°C	9	C255	66.0°C	102.2°C	10	LF2	65.0°C	100.5°C	11	C106	74.7°C	100.0°C	12	C110	68.4°C	104.5°C	13	C15	52.3°C	88.8°C	14	U1	62.7°C	100.4°C	15	C5	52.2°C	89.3°C	16	C200	66.8°C	103.2°C	17	Q101	62.4°C	100.6°C	18	L5	46.6°C	83.7°C	19	T1	96.2°C	106.0°C	20	Q1	60.4°C	100.0°C	21	C72	60.8°C	99.0°C	22	D22	78.7°C	118.6°C		
NO	Position	ROOM AMBIENT Ta= 25.5 °C	HIGH AMBIENT Ta= 60.5 °C																																																																																													
1	L3	44.0°C	81.4°C																																																																																													
2	C2	51.1°C	88.4°C																																																																																													
3	ZR4	57.2°C	93.7°C																																																																																													
4	C125	55.8°C	93.3°C																																																																																													
5	LF10	70.5°C	107.7°C																																																																																													
6	U100	72.9°C	110.1°C																																																																																													
7	D10	68.2°C	104.3°C																																																																																													
8	D7	60.5°C	97.2°C																																																																																													
9	C255	66.0°C	102.2°C																																																																																													
10	LF2	65.0°C	100.5°C																																																																																													
11	C106	74.7°C	100.0°C																																																																																													
12	C110	68.4°C	104.5°C																																																																																													
13	C15	52.3°C	88.8°C																																																																																													
14	U1	62.7°C	100.4°C																																																																																													
15	C5	52.2°C	89.3°C																																																																																													
16	C200	66.8°C	103.2°C																																																																																													
17	Q101	62.4°C	100.6°C																																																																																													
18	L5	46.6°C	83.7°C																																																																																													
19	T1	96.2°C	106.0°C																																																																																													
20	Q1	60.4°C	100.0°C																																																																																													
21	C72	60.8°C	99.0°C																																																																																													
22	D22	78.7°C	118.6°C																																																																																													
2	OVER LOAD BURN-IN TEST	NO DAMAGE 1 HOUR (MIN)	I/P : 400 VAC O/P : 116% LOAD Ta : 25°C	TEST : OK																																																																																												
3	LOW TEMPERATURE TURN ON TEST	TURN ON AFTER 2 HOUR	I/P : 550VAC/340VAC O/P : 100 % LOAD Ta= -30 °C	TEST : OK																																																																																												



240W Slim Three Phase Industrial DIN
Rail with PFC Function

TDR-240 series

4	HIGH HUMIDITY HIGH TEMPERATURE HIGH VOLTAGE TURN ON TEST	AFTER 12 HOURS IN CHAMBER ON CONTROL 60°C / 95 %R.H NO DAMAGE	I/P : 560 VAC O/P : FULL LOAD Ta= 60 °C HUMIDITY= 95 %R.H	TEST : OK												
5	TEMPERATURE COEFFICIENT	± 0.05%/°C (0~60°C)	I/P : 400 VAC O/P : FULL LOAD	± 0.026 %/°C (0~60°C)												
6	STORAGE TEMPERATURE TEST	1. Thermal shock Temperature : -45°C~ +90°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 10 CYCLE 5. Input/Output condition : STATIC		TEST : OK												
7	THERMAL SHOCK TEST	1. Thermal shock Temperature : -35°C~ +65°C 2. Temperature change rate : 25°C / MIN 3. Dwell time low and high temperature : 30 MIN/EACH 4. Total test cycle : 16 CYCLE 5. Input/Output condition : 15cycle:400V/ FULL LOAD AC ON 3sec/AC OFF 1sec TEST 1cycle:400V/ FULL LOAD Burn In Test		TEST : OK												
8	VIBRATION TEST	1 Carton & 1 Set (1) Waveform : Sine Wave (2) Frequency : 10~500Hz (3) Sweep Time : 10min/sweep cycle (4) Acceleration : 3G (5) Test Time : 180min in each axis (X.Y.Z) (6) Ta : 25°C 2 Din Rail <table border="1" style="width: 100%; border-collapse: collapse;"> <thead> <tr> <th></th> <th>Displacement</th> <th>Acceleration</th> </tr> </thead> <tbody> <tr> <td>2 (+3/-0) Hz up to 15Hz</td> <td>± 2.5mm</td> <td>-----</td> </tr> <tr> <td>15Hz up to 50Hz</td> <td>-----</td> <td>2.3g</td> </tr> <tr> <td>Sweep rate</td> <td colspan="2">Max 1 Octave/minute</td> </tr> </tbody> </table>			Displacement	Acceleration	2 (+3/-0) Hz up to 15Hz	± 2.5mm	-----	15Hz up to 50Hz	-----	2.3g	Sweep rate	Max 1 Octave/minute		TEST : OK
	Displacement	Acceleration														
2 (+3/-0) Hz up to 15Hz	± 2.5mm	-----														
15Hz up to 50Hz	-----	2.3g														
Sweep rate	Max 1 Octave/minute															
9	CAPACITOR LIFE CYCLE	SUPPOSE C106 IS THE MOST CRITICAL COMPONENT (1) I/P : 400VAC O/P : FULL LOAD Ta= 25 °C LIFE TIME (2) I/P : 400VAC O/P : FULL LOAD Ta= 60 °C LIFE TIME (3) I/P : 400VAC O/P : 75% LOAD Ta= 60 °C LIFE TIME (4) I/P : 400VAC O/P : 50% LOAD Ta= 60 °C LIFE TIME		(1) 106475.4 HRS (2) 36877.5 HRS (3) 78848.6 HRS (4) 166200.3 HRS												
10	MTBF	Conducted by Parts Stress Analysis Prediction 1534.9K hrs min. Telcordia SR-332 (Bellcore) ; 215.6K hrs min. MIL-HDBK-217F (25°C)														
11	Ongoing Reliability Test	I/P : 400VAC O/P : FULL LOAD TA=50°C Demonstration Mean Time Between Failure : 30,000 hours														

TEST RESULT	TESTER	REVIEW	APPROVAL
PASS	LIUTT		Wangdz

2018.4.30 GP-A50-F010